[illegible]

Manhard
CONSULTING

One Overlook Park, Suite 200, Uaukegan, IL 60089
ph/617.854.5500 fax/617.854.0056 manhard.com
Civil Engineers • Surveyors • Water Resource Engineers • Water & Wastewater Engineers
Construction Managers • Environmental Scientists • Landscape Architects • Planners

<p>OAKTON SOCCER FIELD IRRIGATION IMPROVEMENTS</p> <p>CITY OF DES PLAINES, ILLINOIS</p> <p>EXISTING CONDITIONS AND DEMOLITION PLAN</p>

PROJ. MGR.: KRK

PROJ. ASSOC.: KRK

DRAWN BY: ---

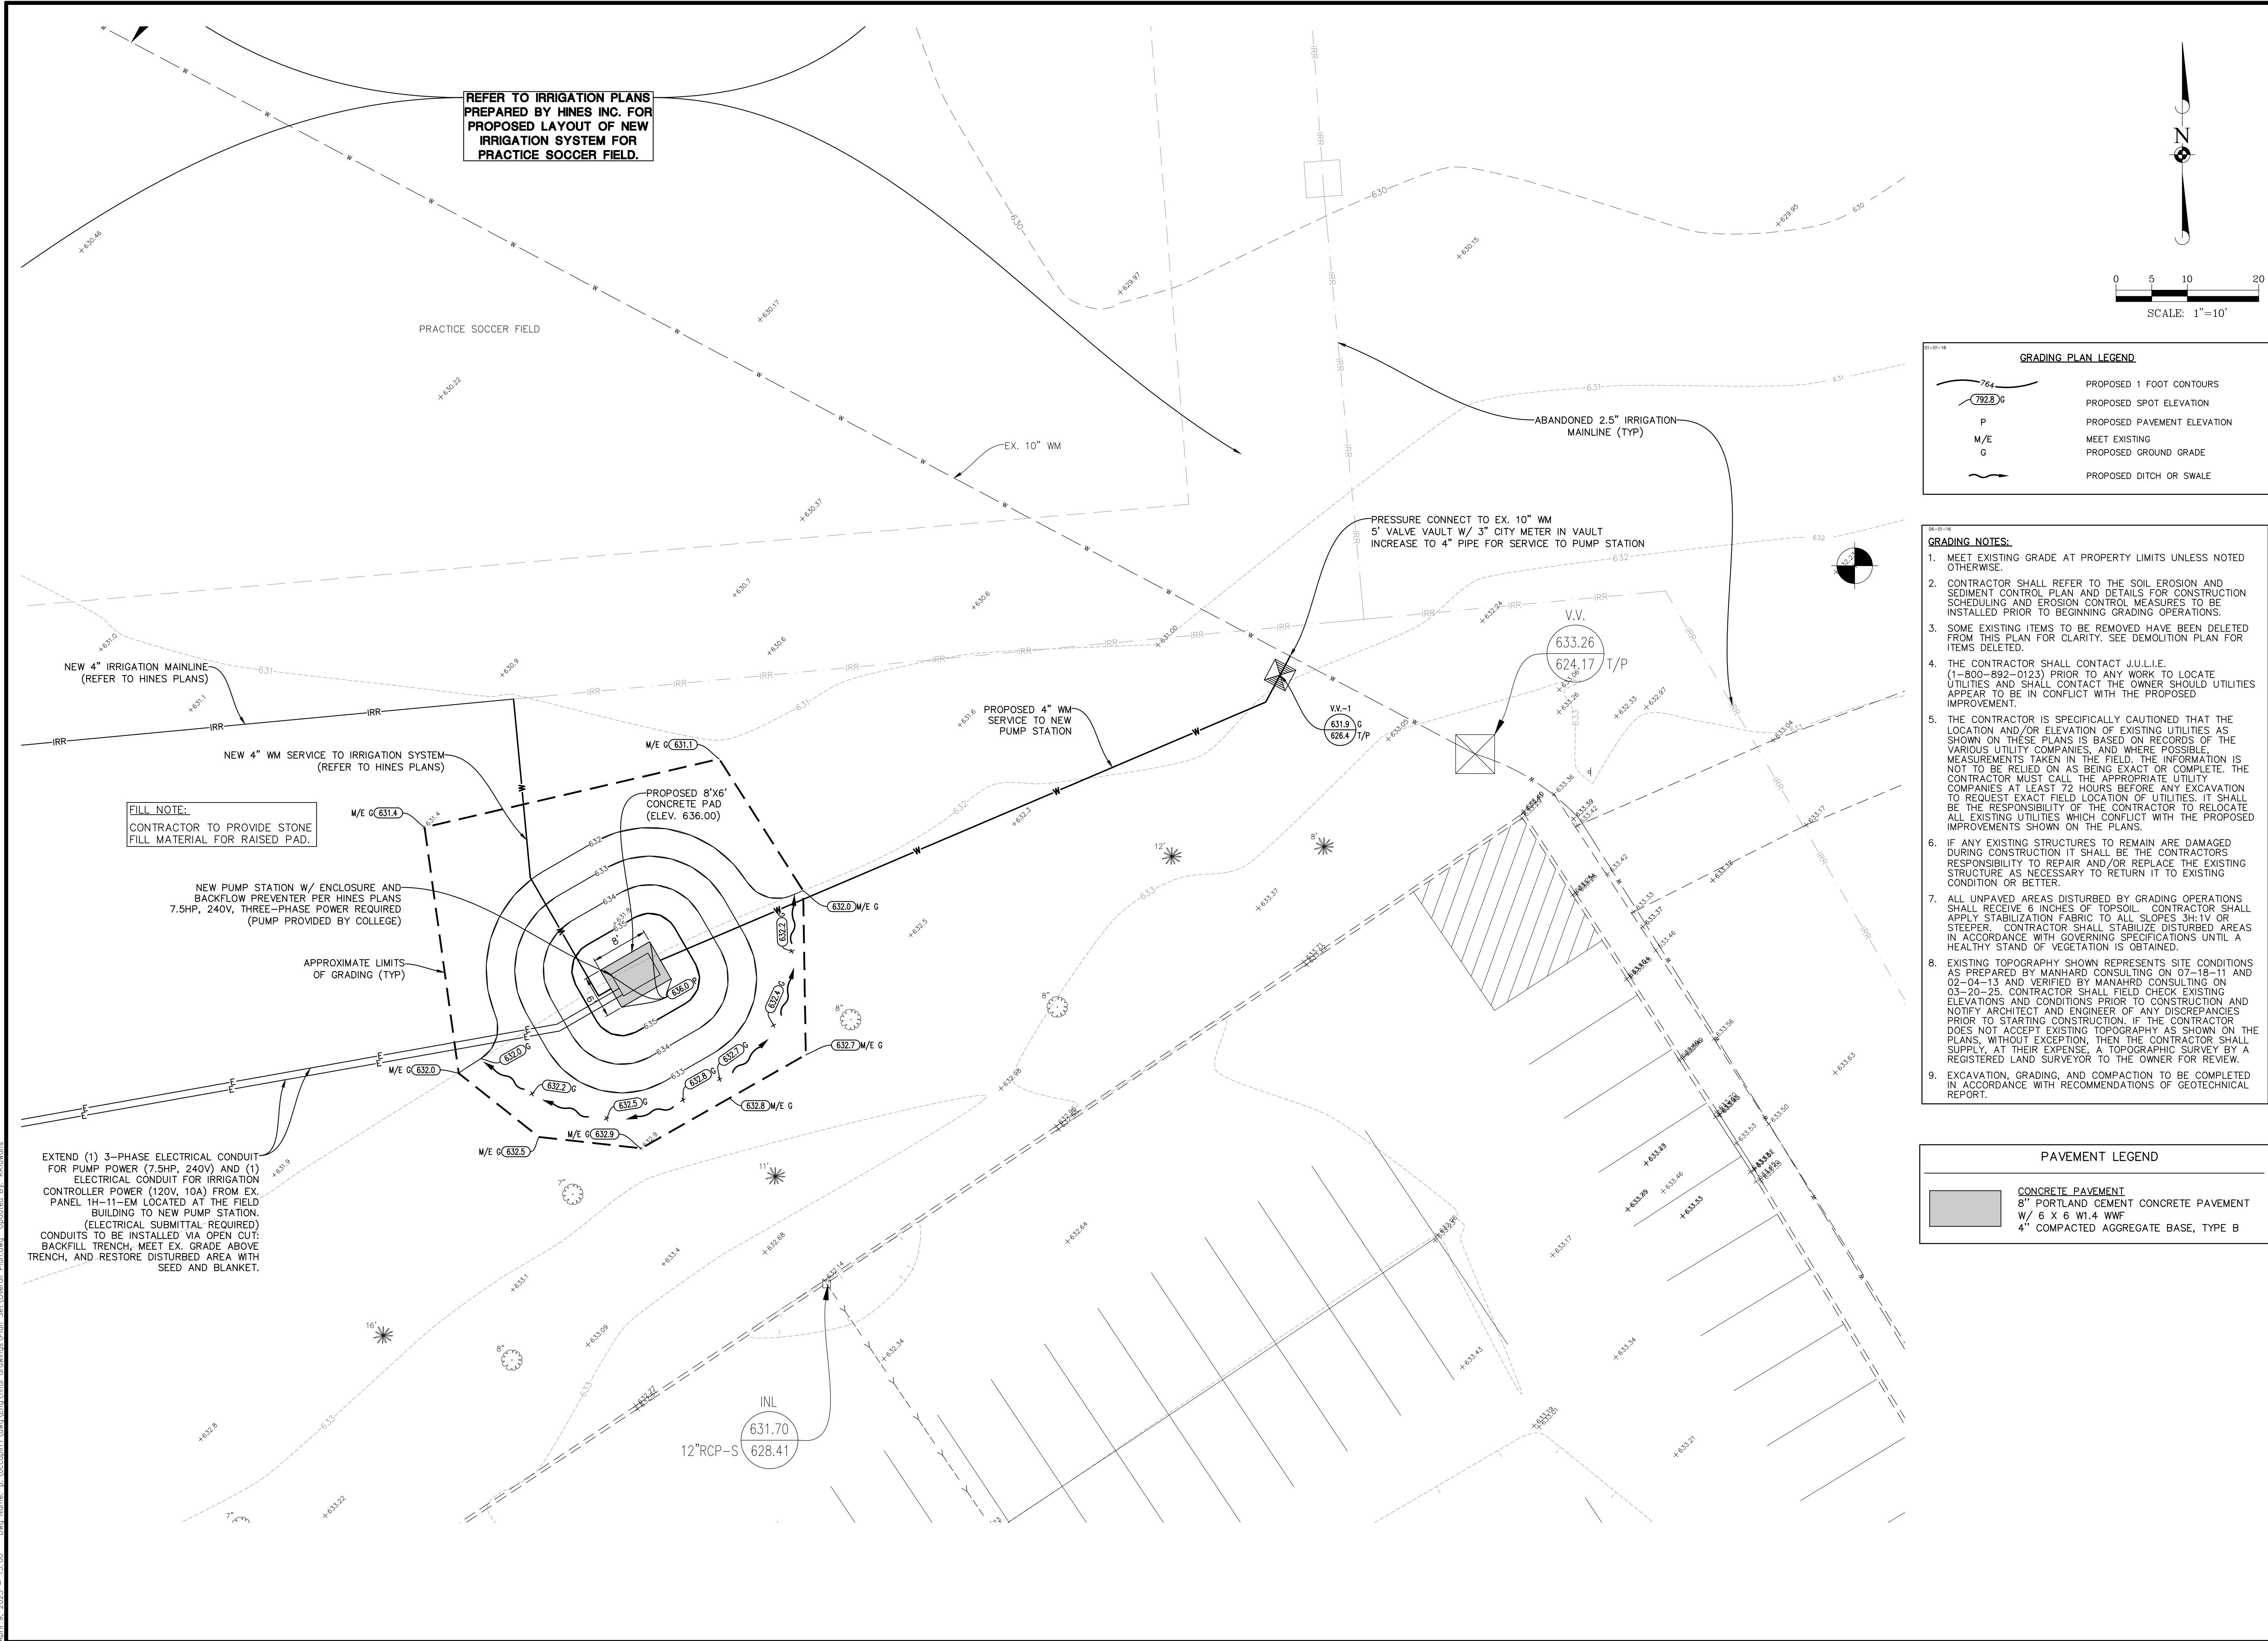
DATE: 04-09-25

SCALE: 1"=30'

SHEET

2 OF 7

OCC.DPIL17

[illegible]

Manhard
CONSULTING

One Westbrook Pointe, Suite 900, Lincolnshire, IL 60068
Tel: 708/794-1550 Fax: 708/794-0065
www.manhard.com

Engineering • Environmental Services • Architectural & Construction Management Services • Landmark Architecture

<p>COAKTON SOCCER FIELD IRRIGATION IMPROVEMENTS</p>	<p>CITY OF DES PLAINES, ILLINOIS</p>	<p>PUMP STATION SITE AND GRADING DETAIL</p>
--	---	--

PROJ. MGR.: KRK
 PROJ. ASSOC.: KRK
 DRAWN BY: ----
 DATE: 04-09-25
 SCALE: 1"=10'

SHEET

4 OF 7

OCC.DPIL17



A = Kentucky Bluegrass @ 90 lbs/ac. Mixed with Perennial Ryegrass @ 30 lbs/ac.
B = Kentucky Bluegrass @ 135 lbs/ac. Mixed with Perennial Ryegrass @ 45 lbs/ac.
C = Spring Oats @ 100 lbs/ac.
D = Wheat or Cereal rye @ 150 lbs/ac.
E = Sod
F = Straw Mulch (Hydromulch or use Straw Blanket) @ 2 tons/ac.
XXX = Irrigation needed

Irrigation should be provided as necessary to thoroughly establish intended growth.



SHOULD A CONFLICT ARISE BETWEEN MANHARD
DETAILS AND THE CITY DETAILS, THE CITY
DETAILS SHALL TAKE PRECEDENCE.

MANHARD CONSULTING
STANDARD SPECIFICATIONS

GENERAL CONDITIONS

CONTRACTOR acknowledges and agrees that the use and reliance of these Plans and Specifications is sufficient consideration for CONTRACTOR'S covenants stated herein.

DEFINITION OF TERMS

- "CLIENT" shall mean OAKTON COMMUNITY COLLEGE, which is the person or entity with whom Manhard Consulting has contracted with to prepare Civil Engineering PLANS and SPECIFICATIONS.
- "ENGINEER" shall mean Manhard Consulting, a Civil Engineering consultant on the subject project.
- "PLANS and SPECIFICATIONS" shall mean the Civil Engineering PLANS and SPECIFICATIONS prepared by the ENGINEER, which may be a part of the contract documents for the subject project.
- "CONTRACTOR" shall mean any person or entity performing any work described in the PLANS and SPECIFICATIONS.
- "JURISDICTIONAL GOVERNMENTAL ENTITY" shall mean any municipal, county, state or federal unit of government from whom an approval, permit and/or review is required for any aspect of the subject project.

INTENT OF THE PLANS AND SPECIFICATIONS

The intent of the PLANS and SPECIFICATIONS is to set forth certain requirements of performance, type of equipment and structures, and standards of materials and construction. They may also identify labor and materials, equipment and methods of construction for the proper execution of the work but are not intended to be infinitely determined so as to include minor items obviously required as part of the work. The PLANS and SPECIFICATIONS require new material and equipment unless otherwise indicated, and to require complete performance of the work in spite of omissions of specific references to any minor component part. It is not intended, however, that materials or work not covered by or properly inferred from any heading, branch, class or trade of the SPECIFICATIONS shall be supplied unless distinctly so noted. Materials or work described in words, which so applied have a well-known technical or trade meaning, shall be held to refer to those specific recognized standards.

INTERPRETATION OF PLANS AND SPECIFICATIONS

- The CLIENT and/or CONTRACTOR shall promptly report any errors or ambiguities in the PLANS and SPECIFICATIONS to the ENGINEER. Questions as to meaning of PLANS and SPECIFICATIONS shall be interpreted by the ENGINEER, whose decision shall be final and binding on all parties concerned.
- The ENGINEER will provide the CLIENT with such information as may be required to show revised or additional details of construction.
- Should any discrepancies or conflicts on the PLANS or SPECIFICATIONS be discovered either prior to or after award of the contract, the ENGINEER'S attention shall be called to the same before the work is begun thereon and the proper corrections made. Neither the CLIENT nor the CONTRACTOR may take advantage of any error or omissions in the PLANS and SPECIFICATIONS. The ENGINEER will provide information when errors or omissions are discovered.

GOVERNING BODIES

All works herein proposed shall be completed in accordance with all requirements of any JURISDICTIONAL GOVERNMENTAL ENTITY, and all such pertinent laws, directives, ordinances and the like shall be considered to be a part of these SPECIFICATIONS. If a discrepancy is noted between the PLANS and SPECIFICATIONS and requirements of any JURISDICTIONAL GOVERNMENTAL ENTITY, the CLIENT and/or the CONTRACTOR shall immediately notify the ENGINEER in writing.

LOCATION OF UNDERGROUND FACILITIES AND UTILITIES

When the PLANS and SPECIFICATIONS include information pertaining to the location of existing underground facilities and utilities (including but not limited to water mains, sanitary sewers, storm sewers, electric, telephone, gas and cable TV lines), such information represents only the opinion of the ENGINEER as to the approximate location of such facilities and utilities. At the locations wherein detailed positions of these facilities and utilities become necessary to the new construction, including all points of connection, the CONTRACTOR shall furnish all labor and tools to verify or definitely establish the horizontal location, elevation, size and material (if appropriate) of the facilities and utilities. The CONTRACTOR shall notify the ENGINEER at least 48 hours prior to construction if any discrepancies in existing utility information or conflicts with existing utilities exist. The ENGINEER assumes no responsibility whatever with respect to the sufficiency or accuracy of the information shown on the PLANS and SPECIFICATIONS relative to the location of underground facilities and utilities, nor the manner in which they are removed or adjusted.

It shall be the CONTRACTOR'S responsibility prior to construction, to notify all Utility Companies of the intent to begin construction and to verify the actual location of all such facilities and utilities. The CONTRACTOR shall also obtain from the respective Utility Companies the working schedules for removing or adjusting these facilities.

UNSUITABLE SOILS

The PLANS have been prepared by the ENGINEER based on the assumption that all soils on the project are suitable to support the proposed improvements shown. The CLIENT or CONTRACTOR shall immediately notify the ENGINEER if he discovers or encounters an obstruction that prevents the installation of the improvement according to the line and grades shown on the PLANS.

PROTECTION OF TREES

All trees that are not to be removed shall be protected from damage. Trees shall not be removed unless requested to do so in writing by the CLIENT.

NOTIFICATION OF OWNERS OF FACILITIES AND UTILITIES

The CONTRACTOR shall notify all applicable Jurisdictional Governmental Entities or utility companies, i.e., water, sewer, electric, telephone, gas and cable TV prior to beginning any construction so that said entity or company can establish the location and elevation of underground pipes, conduits or cables adjoining or crossing proposed construction.

TRAFFIC CONTROL

The CONTRACTOR shall provide when required by any JURISDICTIONAL GOVERNMENTAL ENTITY, all signs, equipment, and personnel necessary to provide for safe and efficient traffic flow in all areas where the work will interrupt, interfere or cause a change in any form, the conditions of traffic flow that existed prior to the commencement of any portions of the work. The CLIENT may, at his discretion, require the CONTRACTOR to furnish traffic control under these or other circumstances where in his opinion it is necessary for the protection of life and property. Emergency vehicle access shall be maintained at all times. Unless authorized by the CLIENT or CLIENT'S construction representative, all existing access points shall be maintained at all times by the CONTRACTOR. The need for traffic control shall be anticipated by the CLIENT.

WORK AREA

The CONTRACTOR, his agents and employees and their employees and all equipment, machinery and vehicles shall confine their work within the boundaries of the project or work area specified by the Client. The CONTRACTOR shall be solely liable for damage caused by him or his agents and employees and their equipment, machinery and vehicles on adjacent property or areas outside designated work areas.

UTILITY POLES

It shall be the responsibility of the CONTRACTOR to arrange for the relocation or bracing of existing utility poles that may be within the working limits of this contract. It is expressly understood that all work and costs connected with the maintenance of these utility poles, their temporary relocations, etc., shall be the responsibility of the CLIENT or the CONTRACTOR.

RESTORATION

It is the intent of these SPECIFICATIONS that clean-up and final restoration shall be performed immediately upon completion of each phase of the work, both inside and outside the Project, or when so directed by the CLIENT so that these areas will be restored as nearly as possible to their original condition or better, and shall include but not be limited to, restoration of maintained lawns and rights-of-way, roadways, driveways, sidewalks, ditches, bushes, hedges, trees, shrubs, fences, mailboxes, sewers, drain tiles, water mains, etc.

CLEANING UP

The CONTRACTOR shall at all times keep the premises free from accumulations of waste material or rubbish caused by his employees or work, and at the completion of the work he shall remove all his rubbish, tools, scaffolding and surplus materials and shall leave his work "broom clean" or its equivalent, unless more exactly specified.

ROAD CLEANING

The CONTRACTOR shall maintain roadways adjoining the project site free from mud and debris at all times. If mud and/or debris is carried onto the roadways from vehicles entering onto the highway from either the CONTRACTOR'S trucks, his employees' vehicles, or his material suppliers, the CONTRACTOR shall immediately remove said mud and/or debris.

SAFETY AND PROTECTION

The CONTRACTOR shall be solely and completely responsible for the conditions of the job site, including safety of all persons and property during performance of the work. This requirement shall apply continuously and not be limited to normal working hours. The CONTRACTOR shall comply with all applicable Laws and Regulations relating to the safety of persons or property, or to the protection of persons or property from damage, injury, or loss, and shall erect and maintain all necessary safeguards for such safety and protection. CONTRACTOR'S duties and responsibilities for safety and for protection of the work shall continue until such time as all work is completed and the CLIENT has notified CONTRACTOR that the work is acceptable. The duties of the ENGINEER do not include review of the adequacy of either the CONTRACTOR'S or the general public's safety in, on, or near the construction site.

HOLD HARMLESS

To the fullest extent permitted by law, any CONTRACTOR, material supplier or other entity by use of these plans and specifications hereby waives any right of contribution and agrees to indemnify, defend, save and hold harmless the CLIENT and ENGINEER and its agents, employees and consultants from and against all manner of claims, causes, causes of action, damages, losses and expenses, including but not limited to, attorneys' fees arising out of, resulting from or in connection with the performance of any work, pursuant to or with respect to these plans and specifications. However, this indemnity shall not be construed to indemnify ENGINEER, its consultants, agents or employees against its own negligence.

Claims, damages, losses and expenses as these words are used in the Agreement shall mean and include, but not be limited to (1) injury or damage occurring by reason of the failure of or use or misuse of any of host, riggings, blocking, scaffolding or any and all other kinds of items of equipment, whether or not the same be owned, furnished or loaned by any part or entity, including any contractor; (2) all attorneys' fees and costs incurred in bringing an action to enforce the provisions of this indemnity; (3) costs for time expended by the indemnified party and its employees, at its usual rates plus costs or travel, long distance telephone and reproduction of documents and (4) consequential damages.

In any and all claims against the CLIENT or ENGINEER or any of their agents or employees and consultants by any party, including any employee of the CONTRACTOR or any Subcontractor, anyone directly or indirectly employed by any of them or anyone for whose acts any of them may be liable, the indemnification obligation shall not be limited in any way by any limitation on the amount or type of damages, compensation or benefits payable by or for the CONTRACTOR or any Subcontractor under workers' or workmen's compensation acts, disability benefit acts or other employee benefit acts or any insurance maintained by CONTRACTOR or any Subcontractor or any other party.

INSURANCE

Any party using or relying on these plans, including any contractor, material supplier, or other entity shall obtain, (prior to commencing any work) general public liability insurance insuring against all damages and claims for any bodily injuries, death or property damage arising out of any work, including the construction work provided for in these plans, and shall name the CLIENT and ENGINEER and its consultants, agents and representatives as additional insureds to the limits of such insurance policies; provided that any party using or relying on these plans having obligations to maintain specific insurance by reason of any agreement with CLIENT or any CONTRACTOR or ENGINEER shall provide evidence and certificates of insurance as required by such contract or agreement. Such insurance must contain a clause stating that the insurance is primary coverage for ENGINEER and ENGINEER'S other applicable coverage is considered secondary. Policies shall contain a waiver of subrogation against Manhard and Client. Such insurance shall not limit any liability of any party providing work or services or providing materials.

THIRD PARTY BENEFICIARY

Manhard Consulting, the ENGINEER, is intended to be a third party beneficiary of this willing agreement and requirement.

DETAILED SPECIFICATIONS

*I. DEMOLITION

The CONTRACTOR shall coordinate with respective utility companies prior to the removal and/or relocation of utilities. The CONTRACTOR shall coordinate with the utility company concerning portions of work which may be performed by the Utility Company's forces and any fees which are to be paid to the utility company for their services. The CONTRACTOR is responsible for paying for all fees and charges.

Should removal and/or relocation activities damage features indicated to remain, the CONTRACTOR shall provide new materials/structures in accordance with the contract documents. Except for materials designed to be relocated on this plan, all other construction materials shall be new.

Prior to demolition occurring, all erosion control devices are to be installed.

All existing utility lines and conduits located under proposed buildings shall be removed and properly backfilled. All utility lines and conduits located under drives, on-site roads, parking lots or sidewalks shall be filled with a flowable backfill and and plugged. All existing structures shall be removed. All existing utility lines located under landscape areas shall be left in place and plugged at all structures.

The CONTRACTOR is responsible for demolition, removal and disposal (in a location approved by any JURISDICTIONAL GOVERNING ENTITY) of all structures, pads, walls, fences, foundations, road, parking lots, drives, drainage structures, utilities, etc., such that the improvements shown on these plans can be constructed. All demolition work shall be in accordance with all applicable federal, state and local requirements. All facilities to be removed shall be undercut to suitable material and brought to grade with suitable compacted fill material per the specifications.

The CONTRACTOR is responsible for obtaining all permits required for demolition and disposal.

Electrical, telephone, cable, water, fiber optic cable and/or gas lines needing to be removed shall be coordinated by the CONTRACTOR with the affected utility company. CONTRACTOR must protect the public at all times with fencing, barricades, endusers, and other appropriate best management practices.

Continuous access shall be maintained for surrounding properties at all times during demolition.

All fire access lanes within the project area shall remain in service, clean of debris, and accessible for use by emergency vehicles.

CONTRACTOR shall maintain all existing parking areas, sidewalks, drives, etc. clear and free from any construction activity and/or material to ensure easy and safe pedestrian and vehicular traffic to and from the site. CONTRACTOR shall coordinate/phase all construction activity within proximity of the building and utility interruptions with the facility manager to minimize disturbance and inconvenience to facility operations.

CONTRACTOR may limit saw-cut and pavement removal to only those areas where it is required as shown on these construction plans, however if any damage is

incurred on any of the surrounding pavement, etc., the CONTRACTOR shall be responsible for ITS removal and repair.

Any existing walls encountered shall be exposed and sealed 3' below proposed finish grade by the CONTRACTOR in accordance with Section 920.120 (latest edition) of the Illinois Water Well Construction Code, Department of Public Health, and all applicable local rules and regulations. CONTRACTOR is responsible for obtaining all permits required by JURISDICTIONAL GOVERNMENTAL ENTITIES for abandoning existing wells.

Any existing septic tanks and grease traps encountered shall have all liquids and solids removed and disposed of by a licensed commercial hauler in accordance with JURISDICTIONAL GOVERNING ENTITY regulations, and the tank and grease traps shall then be filled with suitable materials or removed from the site and disposed of by the CONTRACTOR.

Voids left by any item removed under any proposed building, pavement, walk, etc. or within 24' thereof shall be filled and compacted with suitable materials by the CONTRACTOR.

Any material containing asbestos found within existing structures shall be removed from the site and disposed of off-site by the CONTRACTOR in accordance with County, State and Federal regulations.

CONTRACTOR shall develop and implement a daily program of dust control and shall submit and obtain JURISDICTIONAL GOVERNING ENTITY approval of dust control procedures prior to demolition of any structures. Modification of dust control procedures shall be performed by the CONTRACTOR to the satisfaction of the JURISDICTIONAL GOVERNING ENTITY as requested.

The CONTRACTOR shall coordinate all demolition of the JURISDICTIONAL GOVERNING ENTITY and CLIENT to ensure protection and maintenance of sanitary sewer and water utilities as necessary and to provide stormwater conveyance until new facilities are constructed, tested and placed into operation.

The locations of all existing utilities shown on this plan have been determined from the best information available and are given for the convenience of the CONTRACTOR and are not to be interpreted as the exact location, or as the only obstacles that may occur on the site. The ENGINEER assumes no responsibility for their accuracy. Prior to the start of any demolition activity, the CONTRACTOR shall notify the utility companies for location of existing utilities and shall verify existing conditions and proceed with caution around any anticipated features.

The CONTRACTOR is responsible for removing the existing irrigation system in the areas of proposed improvements. The contractor shall cap the existing irrigation system to remain such that the remaining system can continue to function properly.

The parking lot shall be completed in sections such that it does not interrupt the facility operations. The CONTRACTOR shall coordinate with the construction manager for work to be performed.

II.EARTHWORK

STANDARDS

The work shall be completed in conformance with the applicable sections of the Standard Specifications for Road and Bridge Construction, Department of Transportation, State of Illinois, latest edition except as modified below.

SOIL BORING DATA

Copies of results of soil boring and reports, if such borings were taken by the CLIENT in the vicinity of the proposed construction site, should be made available by the CLIENT to the CONTRACTOR. These borings are presented for whatever purpose the CONTRACTOR chooses to make of them. The ENGINEER makes no representation or warranty regarding the number, location, spacing or depth of borings taken, nor of the accuracy or reliability of the information given in the results thereof.

Further, the ENGINEER does not assume responsibility for the possibility that during construction, the soil and groundwater condition may be different than indicated. Neither does the ENGINEER assume responsibility for variations of soil and groundwater at location between borings. The CONTRACTOR is required to make its own borings, explorations and observations to determine soil and groundwater conditions.

EARTHWORK CALCULATIONS AND CROSS SECTIONS

The CONTRACTOR understands that any earthwork calculations, quantities or cross sections that have been furnished by the ENGINEER are for information only and are provided without any guarantee by the CLIENT or ENGINEER whatsoever as to their sufficiency or accuracy. CONTRACTOR warrants that he has performed his own subsurface investigations as necessary and his own calculations and cross sections to determine site soil conditions and earthwork volumes. The ENGINEER makes no representation or guarantee regarding earthwork quantities and that the earthwork for this project will balance due to the varying field conditions, changing soil types, allowable construction tolerances and construction methods that are beyond the control of the ENGINEER.

CLEARING, GRUBBING AND TREE REMOVAL

The site shall be cleared, grubbed, and trees and stumps removed where designated on the PLANS. Trees designated to remain shall be protected from damage.

TOPSOIL STRIPPING

Upon completion of demolition, clearing, grubbing and tree removal, all topsoil shall be stripped from under all buildings and pavements areas, and other areas necessary to complete the work. Topsoil stripped shall be placed in stockpiles in locations as designated by the CLIENT.

TOPSOIL RESPREAD

Upon completion of roadway and/or parking lot improvements and installation of underground utilities a minimum of six inches (6") of topsoil shall be respread over all unpaved areas which have been disturbed by earthwork construction, except building pads and other designated areas, which shall be kept free from topsoil.

SEEDING

Upon completion of topsoil respread, the CONTRACTOR shall apply seed and fertilizer to all respread areas in accordance with IDOT standards or as designated on landscape drawings and specifications provided by the CLIENT.

SODDING

Upon completion of topsoil respread, the CONTRACTOR shall install sod to all areas designated on the plans or as designated on the landscape drawings and specifications provided by the CLIENT.

EXCAVATION AND EMBANKMENT

Upon completion of topsoil stripping, all excavation and embankments shall be completed as shown on the PLANS. All suitable excavated materials shall be placed in stockpiles (moisture conditioned if necessary) and compacted in the embankment areas. The CONTRACTOR shall include all dewatering, temporary ditching and culverts necessary to complete the excavation and embankment.

Specifically included in the scope of Excavation and Embankments is grading and shaping of all cut or fill areas including swales and ditches; handling of sewer spoil, etc., and all work required to provide positive drainage at the end of each working day and upon completion of a section.

The CONTRACTOR shall be responsible for the excavation of all swales and ditches and for the excavation or filling of the roads, building pads and parking lots within the work limits to lines & grades shown on the plans. He shall be responsible for obtaining compaction in accordance with the minimum values listed in the table below for all embankments unless more stringent values are listed in the soils report or are approved by the CLIENT, and to use any method approved by the CLIENT necessary to obtain this compaction (i.e., soil fabric or any underdraining that may be required).

Type Material	Percent Compaction		Pavement & Floor Slabs		Grass Areas
	Standard	Compaction	Standard	Compaction	
Sandy Soils	Modified Proctor	95%	90%	90%	
Clayey Soils	Standard Proctor	95%	95%	95%	

The CONTRACTOR shall notify the CLIENT if proper compaction cannot be obtained so that the CLIENT may determine what remedial measures may be needed.

A soils testing firm employed by the CLIENT shall determine which soils are unsuitable. Materials in their natural state being defined as unsuitable that would be suitable material if moisture conditioned, shall be conditioned by the CONTRACTOR and used as suitable embankment material or hauled from the site.

For purposes of definition, unsuitable material shall be as follows unless determined otherwise by the Soils Engineer:

- Any soil whose optimum moisture content exceeds 25%.
- Any cohesive soil with an unconfined compressive strength of 1.5 tons per square foot or less.
- Any soil whose silt content exceeds 60% by weight.
- Any soil whose maximum density is less than 100 pounds per cubic foot.
- Any soil containing organic, deleterious, or hazardous material.

Upon completion of excavation and shaping of the water retention areas intended to maintain a permanent pool of water, all silt seams and granular or sandy soils shall be removed to a minimum depth of three feet below the subgrade and replaced with an impermeable clay liner, including adjacent to and under storm sewer inlets and outlets. It is the intent of these PLANS and SPECIFICATIONS that the CONTRACTOR shall prepare the lake bottom, side slopes, and compaction thereof such that the lakes will maintain the proposed normal water level and that leakage does not exceed ½" inch per week.

Ditches and swales are to be excavated to the lines and grades indicated on the PLANS. All suitable materials excavated from the ditches shall be used in construction of the embankments.

The CONTRACTOR shall notify the CLIENT immediately upon encountering groundwater during excavation. If in the opinion of the CLIENT or the JURISDICTIONAL GOVERNING ENTITY this condition necessitates the installation of perforated drain tile bedded in washed gravel or open storm sewer joints wrapped with fabric, the CONTRACTOR shall install the same.

During excavation and embankment, grades may be adjusted to achieve an overall site earthwork balance. The CONTRACTOR shall cooperate fully with the CLIENT in adjustment of grades, construction methods and placement of material to meet the above goals and shall immediately advise CLIENT if he believes that the earthwork will not balance.

It is the intent of these PLANS that storm waters falling on the site be diverted into sedimentation / lake / detention basins during construction. The CONTRACTOR shall construct and maintain any temporary ditches or swales that are necessary to accomplish this prior to beginning mass excavation.

EROSION CONTROL

Suitable erosion control practices shall be maintained by the CONTRACTOR in accordance with Illinois Urban Manual and all applicable Soil Erosion and Sedimentation Control ordinances and the PLANS.

UNDERCUTTING DURING EARTHWORK

If the subgrade cannot be dried adequately by dicing as outlined above for placement of material to planned grades and if the CLIENT determines that the subgrade does not meet the standards set forth above, the CLIENT may require undercutting.

MISCELLANEOUS CONTRACT ITEMS

The following items may be required at the CLIENT'S option, as indicated on the PLANS or as required by the JURISDICTIONAL GOVERNING ENTITY:

- GEOTEXTILE FABRIC**
Geotextile fabric or approved equal shall be provided in areas as designated by the CLIENT, as indicated on the PLANS or as required by the JURISDICTIONAL GOVERNING ENTITY where proper compaction of embankments over existing soft soils is not possible. Geotextile fabric shall meet the material specifications of and shall be installed in accordance with the above standards.
- EROSION CONTROL BLANKET**
Erosion control blanket or approved equal shall be provided in areas as designated by the CLIENT, as indicated on the PLANS or as required by the JURISDICTIONAL GOVERNING ENTITY for the stabilization of disturbed areas. Erosion control blanket shall meet the material specifications of and shall be installed in accordance with the above standards, the Illinois Urban Manual and/or the details shown on the PLANS.

III.UNDERGROUND IMPROVEMENTS

A. GENERAL

STANDARDS

All underground improvements shall be constructed and tested in accordance with the Standard Specifications for Water and Sewer Construction in Illinois and Standard Specifications for Road and Bridge Construction, Department of Transportation, State of Illinois, latest edition. In the event of conflicting guidelines, the more restrictive shall govern.

SELECTED GRANULAR BACKFILL

Selected Granular Backfill shall be required for all sewer and water main trenches lying under existing or proposed streets, driveways, parking lots and within 24" thereof, and where noted on plans shall be installed in such trenches shall be in accordance with the above standards.

MANHOLES, CATCH BASIN, INLETS & VALVE VAULTS

All Manholes, Catch Basins, Inlets, and Valve Vaults shall be constructed of reinforced precast concrete ring construction with tongue and groove joints in conformance with the latest revision of ASTM designation C-478. All joints between sections and frames (except sanitary manholes, see Section IIB Manholes, below) shall be sealed with mastic type bituminous jointing compound. CONTRACTOR shall remove all excess mastic on inside of structure and buffer joints with mortar. Manholes are to have offset cones except that no cone shall be used on storm manholes 6'-0" deep or less in which case a reinforced concrete flat top concrete Vault shall be used. Valve Vaults shall have coned adjustment rings and hollyday restrictions for scheduling purposes. The CONTRACTOR shall be aware of jurisdictional rules and regulations and hollyday restrictions for scheduling purposes.

The CONTRACTOR is responsible for guard fresh concrete until it sets and hardens sufficiently to prevent people from writing, walking, riding bicycles or otherwise permanently marking, defacing or causing depressions of any type in the concrete. Any concrete so marked will be removed and replaced by the CONTRACTOR at the CONTRACTOR'S expense.

The CONTRACTOR shall protect the pavement against all traffic, including that of their own employees or other workers, until test specimens have attained the specified strength.

*SIDEWALKS - INTENTIONALLY OMITTED

*CURB AND GUTTER - INTENTIONALLY OMITTED

CONCRETE CURB AND GUTTER REMOVAL AND REPLACEMENT

*FRAME ADJUSTMENTS - INTENTIONALLY OMITTED

*PAVEMENT MARKING - PAINT - INTENTIONALLY OMITTED

*PAVEMENT MARKING - THERMOPLASTIC - INTENTIONALLY OMITTED

QUALITY CONTROL

The CONTRACTOR shall provide all testing necessary to ensure improvements are in accordance with the project specifications and provide testing documentation that specifications were met.

Section 41-2.01A and 41-2.01B and Standard Drawing 18, 19, 20, 21, 22, 23 and 24.

STRUCTURE ADJUSTMENTS

Structures shall be adjusted to the finished grade as shown on PLANS.

*B. SANITARY SEWERS AND APPURTENANCES - INTENTIONALLY OMITTED

C. WATER MAINS AND APPURTENANCES

WATER MAIN PIPE (3" AND LARGER)

Water main pipe shall conform to the following:

- Ductile iron pipe shall be per ANSI/AWWA C151/A21.51. Thickness Class 52, minimum 150 psi working pressure, cement lined in accordance with ANSI/AWWA C104/A21.4, with "push on" type joints (2)
- Polyvinyl Chloride Pipe (PVC) conforming to the latest revision of ANSI/AWWA C900 (4-inch thru 12-inch) or ANSI/AWWA C905 (14-inch thru 48-inch) with a pressure rating of 250 psi, SDR 18 in accordance with ASTM D2241. Joints shall be pressure rated in accordance with ASTM D3139 with elastomeric seals in accordance with ASTM F477.

Installation shall be in accordance with ANSI/AWWA C600 (Ductile Iron) or ANSI/AWWA C605 (PVC). All water main shall have mechanical joint cast iron or ductile iron fittings in accordance with ANSI/AWWA C110/A21.10 or compact ductile iron fittings in accordance with ANSI/AWWA C153/A21.53 with 250 psi working pressure.

Poured or monolithic concrete thrust blocks are required to brace all tees, plugs, caps, and bends of 11 1/4 degree deflection or greater. Minimum cover for all water mains, including services, shall be 5'-6" from the finished grade. Water main shall include bedding and backfilling.

WATER VALVES

All valves shall be resilient wedge gate valves conforming to the latest revision of ANSI/AWWA C515, with a rated working pressure of 200 psi in accordance with JURISDICTIONAL GOVERNING ENTITY requirements, except that butterfly valves conforming to ANSI/AWWA C504 shall be constructed on all water mains 16" diameter and larger. Valves shall be non-rising stem and shall close by turning clockwise.

VALVE VAULTS

Valve vaults shall be constructed in conformance with Section IIA Manholes, etc. above. Frame and lids shall be as approved by the JURISDICTIONAL GOVERNING ENTITY and shall be labeled "WATER".

*VALVE BOXES - INTENTIONALLY OMITTED

*FIRE HYDRANTS - INTENTIONALLY OMITTED

TAP, STOPS AND BOX

The CONTRACTOR shall determine from the JURISDICTIONAL GOVERNING ENTITY as to the exact style, type, and manufacture of corporation stops, ground key stops and services boxes preferred by the JURISDICTIONAL GOVERNING ENTITY and shall furnish same.

*SMALL WATER SERVICES (2" DIAMETER OR LESS) - INTENTIONALLY OMITTED

DISINFECTION

Disinfectants shall meet all of the requirements of the State of Illinois, Environmental Protection Agency, Public Water Supplies Division. The safe quality of the water supply shall be demonstrated by bacteriological analysis of samples collected at sampling taps on at least two consecutive days following disinfection of the mains and copies of the said report submitted to the JURISDICTIONAL GOVERNING ENTITY and the CLIENT.

PRESSURE TEST

Allowable leakage, test pressure and duration shall be as per the requirements of the JURISDICTIONAL GOVERNING ENTITY.

PRESSURE CONNECTION TO EXISTING WATER MAIN

The CONTRACTOR shall maintain system pressure on existing water main at all times. Existing water main shall be located and material excavated, and valve basin slab and main supports installed. The existing water main shall be cleaned and the exterior disinfected prior to installing the tapping tee (material to conform to AWWA C110). The tapping valve shall be installed (valve to conform to AWWA C500) and the pressure tap completed in accordance with the detail on the plans. Valve shall be constructed in conformance with the detail. Payment for pressure connection to existing water main shall include disinfection, tapping valve and tee, valve vault, frame and lid, bedding, and trench backfill.

*DRY CONNECTION TO EXISTING WATER MAIN - INTENTIONALLY OMITTED

POLYETHYLENE ENCASEMENT (FOR DUCTILE IRON WATER MAIN ONLY)

The CLIENT, or JURISDICTIONAL GOVERNING ENTITY may request that portions of the water main be encased in a polyethylene encasement in accordance with ANSI/AWWA C105/A21.5 should soil conditions so warrant its use.

FOUNDATION, BEDDING AND HAUNCHING

Foundation, Bedding and Haunching shall be wet coarse aggregate or moist fine aggregate in accordance with the above standards and placed as shown on the detail.

TRACER WIRE

If the distance between valves when installing PVC pipe exceeds 1,000', tracer wire stations will be required for current induction. Tracer wire stations in grass areas will be Rhine Trivertex Fine Tracing Wire Stations or approved equal. In paved areas, they will be Vibroloc Tracer Wire Access Box for 1500' loading or approved equal. For open cut construction, using PVC pipe, a continuous, insulated, 12 gauge copper wire suitable for direct burial shall be taped on top of all piping to provide for locating following construction. This wire shall be securely terminated inside every valve vault on stainless steel hardware with an exposed lead of at least 12". A mechanically secure and soldered connection shall be provided for all wire splices